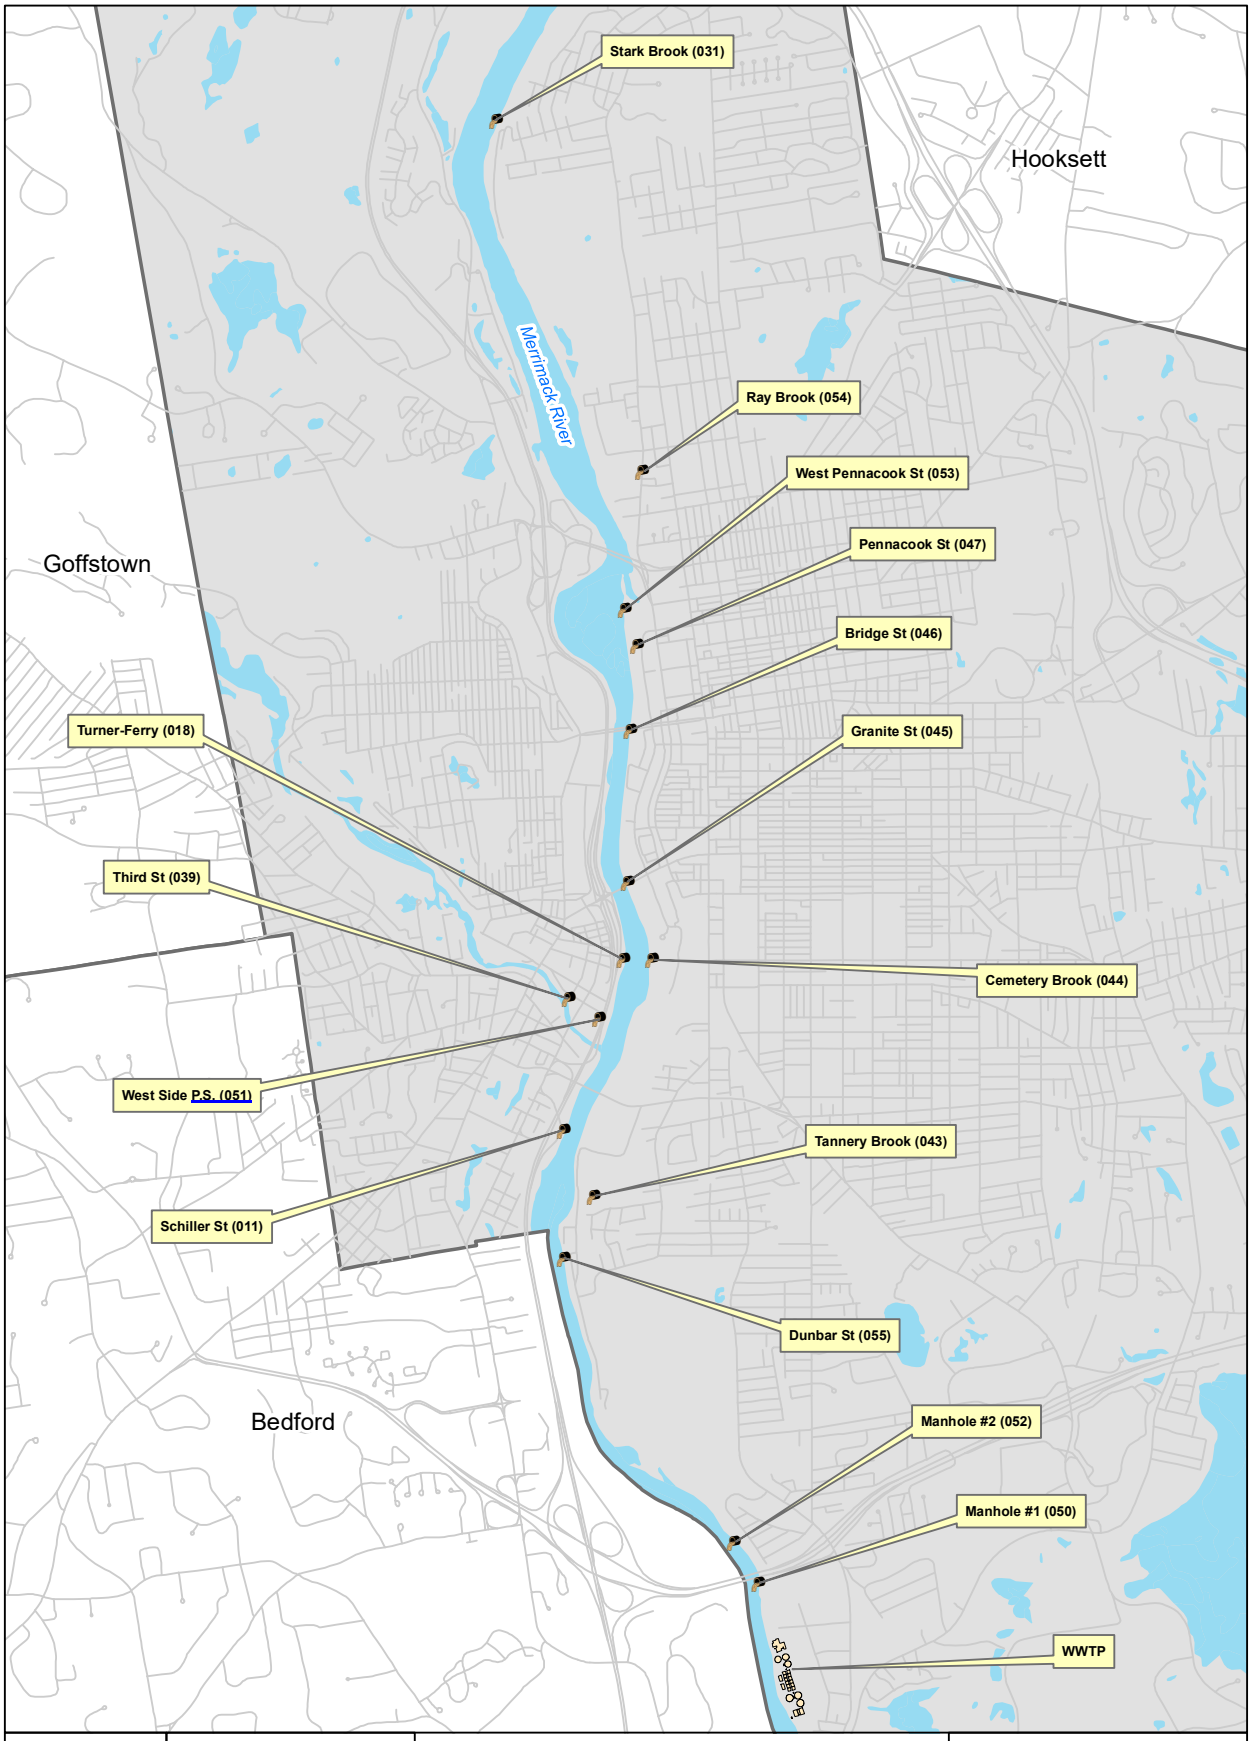

N
W E
S

CDM Smith

CSO Outfalls

0 4,250 8,500 Feet

CSO Outfall Locations

City of Manchester, NH
2019 CSO Consent Decree
October 2019